


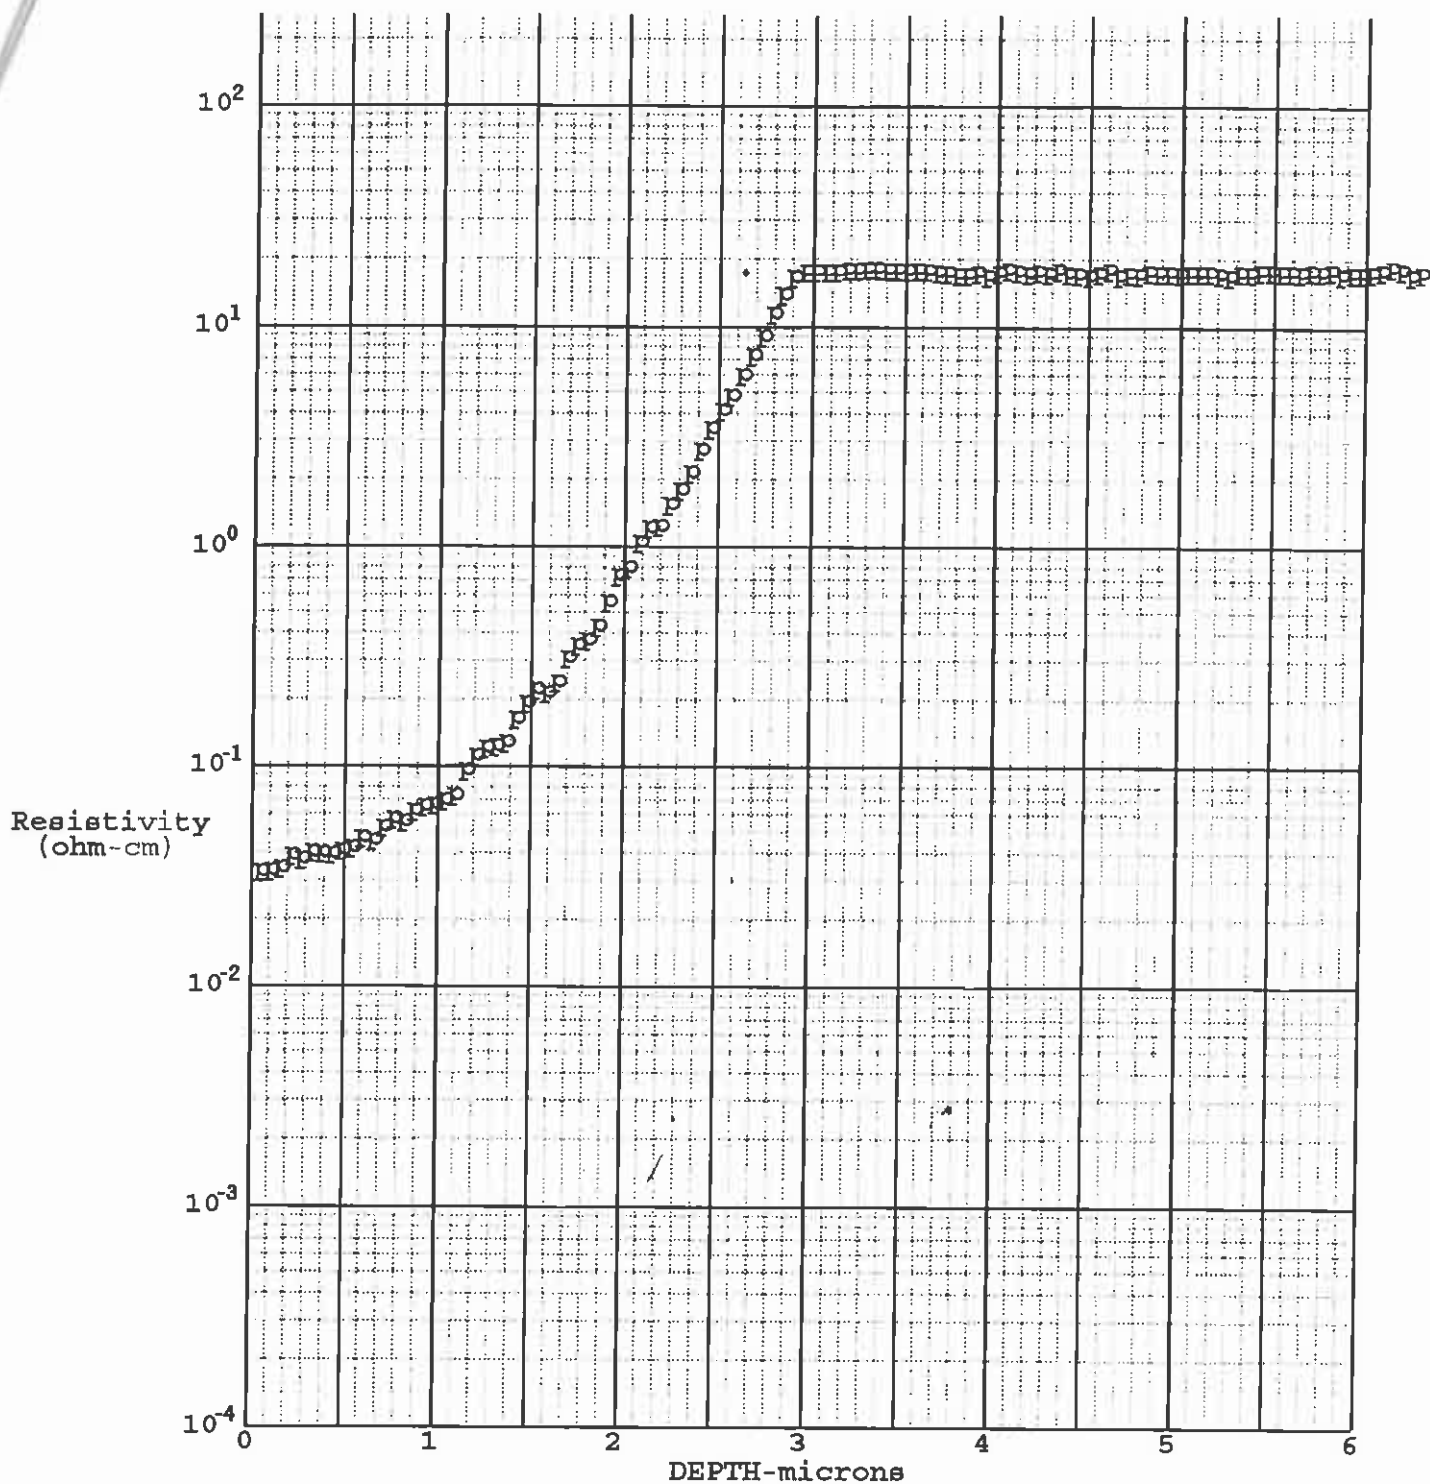

Date 08/04/11

Probe Load 2.5 grams

Orientation <100> S1

File # RNBa0790

Bevel Angle .01095

Step Increment 5 um

Source R.M.D.

Sample #454-1

Job # 1107119

Profile by KRISTEN

